

11653.27.1

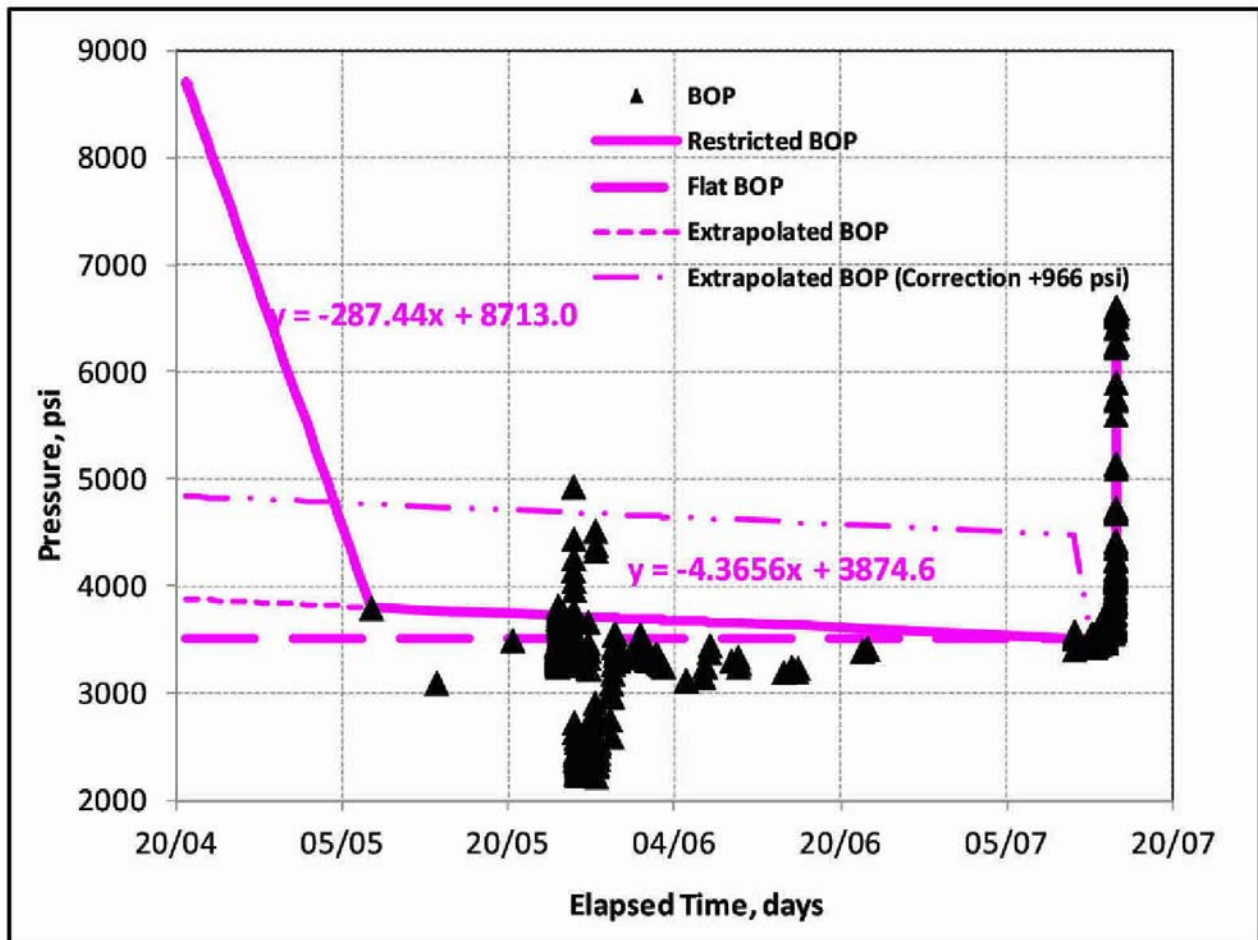


Figure 16: Recorded BOP pressure between May 8 and July 15, indicating erratic and sparse values prior to the integrity test. Also shown are the four sensitivity cases